

# FRANCIS TURBINE SHAFT PROTECTED WITH BELZONA

ID: 3431


Industry: Power  
Application: MPT-Mechanical Power Transmission

Customer Location: Hydroelectric Power Station, France  
Application Date: November 2006

Substrate: Steel  
Products: \* Belzona® 1341 (Supermetaglide) ,  
\* Belzona® 2141 (ACR-Fluid Elastomer) ,  
\* Belzona® 2941 (Elastomer SP-Conditioner) ,

## Problem

Shaft damaged by cavitation and erosion

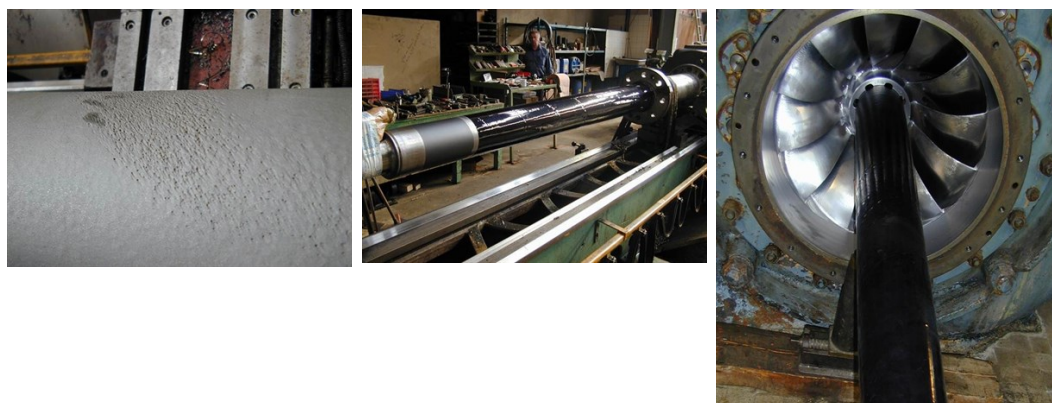

## Photograph Descriptions

- \* Shaft damaged by cavitation/erosion ,
- \* Belzona® 2141 after the application ,
- \* Inspection of Belzona® 2141 protection of the turbine shaft after 9 months in service. ,

## Application Situation

Main shaft, 160 mm diameter, 1000 rpm.

## Application Method

After blasting the surface, Belzona® 1341 was applied in one coat. Belzona® 2941 conditioner was used to tie in the Belzona® 2141 system.

For more examples of Belzona Know - How In Action, please visit <https://khia.belzona.com>

ISO 9001:2015  
FS 695214  
ISO 14001:2015  
EMS 695213

Belzona products are  
manufactured under an ISO  
9000 Registered Quality  
Management System.

[www.belzona.com](http://www.belzona.com)

  
**BELZONA®**  
Repair • Protect • Improve

## Belzona Facts

The application was carried out on the shaft in a lathe and the finish was obtained by using a rubber squeegee. Inspection of the Belzona® 2141 in 2007 and 2010 showed the system still in perfect condition.

---

For more examples of Belzona Know - How In Action, please visit <https://khia.belzona.com>

ISO 9001:2015  
FS 695214  
ISO 14001:2015  
EMS 695213

Belzona products are  
manufactured under an ISO  
9000 Registered Quality  
Management System.

[www.belzona.com](http://www.belzona.com)

