BELZONA STOPS LEAK IN A HYDROPOWER PLANT

ID: 5560

Industry: Power Customer Location: Hydropower Plant, S.E. Washington, USA

Application: TCC-Tanks and Chemical Containment Application Date: February 2015

Areas


Substrate: Steel


Products: * Belzona 1212,

Problem

Weld failure at the bottom of the reservoir resulting in an active oil leak, creating a hazard as well as potential ecological contamination.



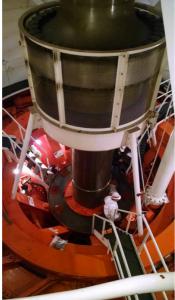





Photograph Descriptions

- * Inside the powerhouse.,
- * Inside the turbine housing.,
- * Active leak.,
- * Completed application.,

Application Situation

Oil sump reservoir in the bottom of a turbine in a hydro dam.

Application Method

For more examples of Belzona Know - How In Action, please visit https://khia.belzona.com

ISO 9001:2015 Belzona products are
FS 695214 manufactured under an ISO
ISO 14001:2015 9000 Registered Quality
EMS 695213 Management System.

www.belzona.com

The existing paint had already been removed to identify the source of the leak. The surrounding surface was properly cleaned and roughened by hand with emery paper. Located at the bottom of a 3' tall reservoir, there was gravitational pressure resulting in a low pressure, slow leak. Using Belzona 1212, an oil tolerant, fast curing material, a small steel plate was bonded over the leak. A second plate was also bonded in a second layer over the repair location to ensure success.

Belzona Facts

Due to the location, the alternative options were to either 1) wait until there was to be a major overhaul of the turbine that required the entire unit be removed or 2) pump the reservoir empty, purge the reservoir to remove flammability and secure a hot work permit to repair by welding. With Belzona 1212, approximately \$50.00 USD was invested for materials, thus providing a safe and cost-effective solution.