

Leaking Porous Weld Repair

ID: 9352

Industry: Water / Wastewater

Customer Location: Ontario

Application: VPF-Valves, Pipes and Fittings


Application Date: November 2023

Substrate: Stainless-steel

Products: Belzona 1111 (Super Metal), Belzona 9111 (Cleaner Degreaser)

Problem

Weld Joint on stainless steel pipe was leaking due to a porosity and slag inclusion

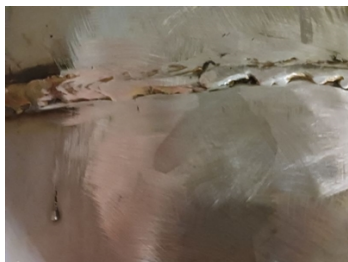

Repair area preparation completed



Belzona 1111 mixed



Application of Belzona 1111



Application completed

Application Situation

The asset owner required a weld joint on the city water tower S/S filling pipe to be repaired without performing hot work and also required a NSF approved product.

Application Method

Preparation was completed in-way of using a grinder with a 80 grit sanding pad, than cleaned with Belzona 9111. Next the Belzona 1111 repair composite was mixed and applied well into the preferred area. Using a piece of Belzona 9341 Reinforcing cloth was wetted out and applied over the repair area with a further layer of Belzona 1111 until the cloth was covered.

Belzona Facts

Sub-Contractor contacted Belzona Great Lakes to discuss solutions the BGL would suggest to be used for this type of repair and also mentioned that a approved NSF-61 product was required.

For more examples of Belzona Know - How In Action, please visit <https://khia.belzona.com>

ISO 9001:2015

FS 695214

ISO 14001:2015

EMS 695213

Belzona products are
manufactured under an ISO
9000 Registered Quality
Management System.

www.belzona.com


BELZONA[®]
Repair • Protect • Improve

Copyright © Belzona International Limited 2024